


HYDRANT SHALL BE PAINTED RED.

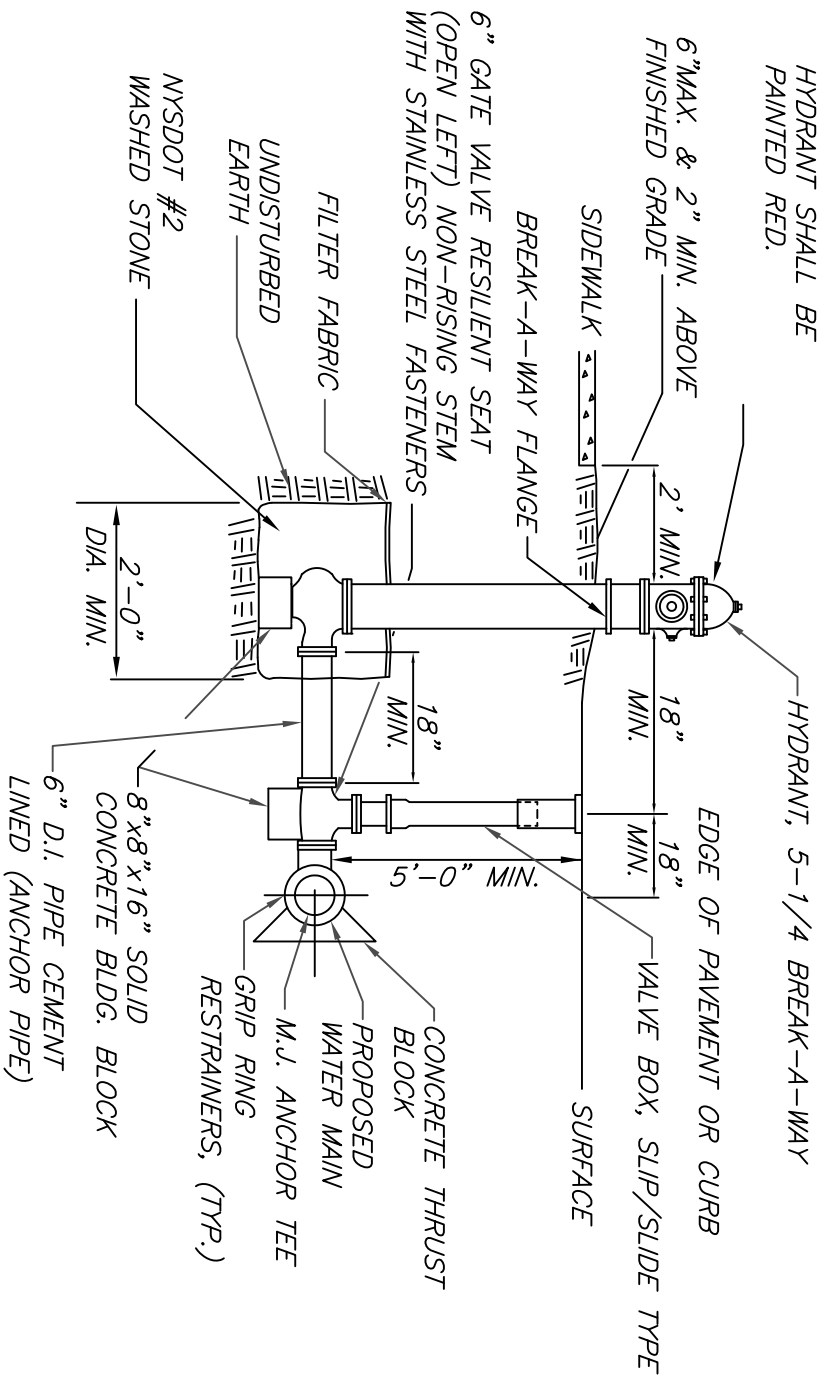

GENERAL NOTES

1. HYDRANT WEEP HOLES SHALL NOT BE PLUGGED UNLESS GROUNDWATER IS ENCOUNTERED WITHIN 7' OF FINISHED GRADE, OR AS DIRECTED BY THE TOWN/VILLAGE ENGINEER.
2. ALL FLANGES ON FIRE HYDRANT LEG TO BE MECHANICAL JOINT RESTRAINING TYPE OF FLANGES. BARREL TO BE SINGLE PIECE - NO EXTENSIONS PERMITTED - MIN 5/8" LENGTH.
3. DIP FITTINGS AND VALVES SHALL BE WRAPPED WITH 6 MIL POLYETHYLENE 2' BEYOND END OF FITTING.
4. ALL NUTS AND BOLTS SHALL BE STAINLESS STEEL.
5. ORIENTATION AND EXACT LOCATION TO BE DETERMINED BY TOWN/VILLAGE ENGINEER.
6. HYDRANTS SHALL BE PAINTED RED.

STANDARDS

1. AWWA C502 - 250PSI WORKING PRESSURE

MANUFACTURER

1. AMERICAN DARLING - MODEL B-84-B-5

FIRE HYDRANT ASSEMBLY
N.T.S.

ISSUE DATE: SEPTEMBER 2018

TOWN & VILLAGE OF ELLICOTTVILLE

REVISIONS	DATE	COMMENTS

EVL ENG DEPT.

WATER - W-02

